



## Specification for safe working in the vicinity of National Gas Transmission high pressure gas pipelines and associated installations - requirements for third parties





## Contents

Disclaimer.....	02
Mandatory and non-mandatory requirements .....	02
Introduction .....	03
1 Scope.....	05
2 Formal consent .....	05
3 HS&E considerations .....	07
4 Pipeline locating .....	08
5 Slabbing and other protective measures.....	09
6 Excavation .....	10
7 Construction traffic .....	14
8 Specific activities .....	15
9 Backfilling .....	20
10 Action in the case of damage to the pipeline.....	20
11 References .....	21
12 Glossary of terms .....	21
13 Privacy notice .....	22
Appendix A - Site Document Control Form.....	22
Appendix B - Pipeline Location Flags .....	24
Contact details.....	25

Emergency telephone number:

**0800 111 999\***

\*All calls are recorded and may be monitored

## Disclaimer

This document is provided for use by third parties for safe working in the vicinity of National Gas Transmission high pressure gas pipelines and associated installations.

Where this document is used by any other party it is the responsibility of that party to ensure that this document is correctly applied.

## Mandatory and non-mandatory requirements

### In this document:

**shall:** indicates a mandatory requirement.

**should:** indicates best practice and is the preferred option. If an alternative method is used then a suitable and sufficient risk assessment shall be completed to show that the alternative method delivers the same, or better, level of protection.

# Introduction

## Specification for safe working in the vicinity of National Gas Transmission high pressure gas pipelines and associated installations – requirements for third parties.

This specification is for issue to third parties carrying out work in the vicinity of National Gas Transmission high pressure gas pipelines (above 7 bar gauge) and associated installations and is provided to ensure that individuals planning and undertaking work take appropriate measures to prevent damage.

Any damage to a high pressure gas pipeline or its coating can affect its integrity and can result in failure of the pipeline with potential serious hazardous consequences for individuals located in the vicinity. It is therefore essential that the procedures outlined in this document are complied with when working near to a high pressure pipeline. If any work is considered by National Gas Transmission to be in breach of the requirements stipulated in this document, then the National Gas Transmission responsible person will suspend the work until the non-compliances have been rectified.

The Pipelines Safety Regulations state that “No person shall cause such damage to a pipeline as may give rise to a danger to persons” (Regulation 15). Failing to comply with these requirements could therefore also result in prosecution by the Health and Safety Executive (HSE).

The requirements in this document are in line with the requirements of the Institution of Gas Engineers and Managers (IGEM) recommendations IGE/SR/18 Edition 2 - Safe Working Practices to Ensure The Integrity Of Gas Pipelines And Associated Installations and the HSE’s guidance document HS(G)47 Avoiding Danger from Underground Services. It is the responsibility of the third party to ensure that any work carried out also conforms with the requirements of the Construction and Design Management Regulations and all other relevant health and safety legislation.

**Always contact National Gas Transmission prior to carrying out any work in the vicinity of a high pressure pipeline.**

**CONTACT NATIONAL GAS TRANSMISSION**  
Submit an enquiry via [www.LSBUD.co.uk](http://www.LSBUD.co.uk) to inform National Gas Transmission of your work.

**CONSIDER SAFETY**  
Consider the safety requirements - Section 3 of this document.

**INFORM NATIONAL GAS TRANSMISSION AND REQUEST PIPELINE LOCATION**  
Inform National Gas Transmission prior to carrying out work and arrange for National Gas Transmission to locate the pipeline - Section 4 of this document.  
Note: at least 14 days' notice is normally required.

**OBSERVE RESTRICTIONS**  
Observe National Gas Transmission restrictions on the allowed proximity of mechanical excavators and other power tools and the measures to protect the pipeline from construction vehicles when carrying out the work - Sections 5, 6 and 7 of this document.  
Note: National Gas Transmission may wish to supervise the work, consult National Gas Transmission to confirm whether or not this is the case.

**SPECIFIC ACTIVITIES (Section 8 of this document)**

No-Dig Techniques Change in Cover Piling Seismic Surveys	Hot Work Blasting Demolition Surface Mineral Extraction	Landfilling Pressure Testing Deep Mining Wind Farms Solar Farms Festivals & Large Gatherings
---	--	---

**CONSULT NATIONAL GAS TRANSMISSION**  
Consult National Gas Transmission prior to any backfilling over, alongside or under the pipeline and obtain National Gas Transmission's agreement to proceed. Normally National Gas Transmission requires 48 hours' notice prior to backfilling - Section 9 of this document.

**IMPORTANT: This flowchart should be used in conjunction with the entire T/SP/SSW/22 document and not in isolation, AND if at any time during the works the pipeline is damaged even slightly then observe the precautions in Section 10 of this document.**

**IF IN DOUBT CONTACT NATIONAL GAS TRANSMISSION.**

## 1 Scope

This specification sets out the safety precautions and other conditions affecting the design, construction and maintenance of services, structures and other works in the vicinity of National Gas Transmission pipelines and associated installations operating at pressures greater than 7 bar gauge, located in both negotiated easements (see Section 12) and public highways.

## 2 Formal consent

High pressure pipelines are generally laid across country within an easement agreed with the landowner or within the highway.

As the required arrangements for working within an easement and working within the highway differ, this document has been structured to highlight the specific requirements for these two types of area where work may be carried out.

In Scotland a 'Deed of Servitude', known generally as a 'wayleave' is considered equivalent to 'easement' in this document.

Generally, normal agricultural activities are not considered to affect the integrity of the pipeline, however, consult National Gas Transmission prior to undertaking deep cultivation in excess of 0.5 m.

In all other cases no work shall be undertaken in the vicinity of the pipeline without the formal written consent of National Gas Transmission.

Any documents handed to contractors, or other individuals undertaking work (e.g. farmer, local authority etc.) on site by National Gas Transmission, shall be signed for by the site manager. National Gas Transmission will record a list of these documents using the form in Appendix A, and the contractor or other individuals undertaking work should maintain a duplicate list.

## 2.1 Within an easement

The promoter of any works (see Section 12) within an easement shall provide National Gas Transmission with details of the proposed works including a method statement of how the work is intended to be carried out. Preliminary investigations such as trial holes, cathodic protection, and coating surveys may be required to assess the feasibility of the work.

If the work involves installing new adopted assets in National Gas Transmission's pipeline easement, formal written consent will be required in the form of a deed of indemnity. Work shall not proceed until formal written consent has been given by National Gas Transmission.

This will include details of National Gas Transmission's protection requirements, contact telephone numbers and the emergency telephone number.

Note: the completion time for a deed of indemnity is a minimum of 6 months and this must be considered during the planning stage of a project.

Any costs incurred by National Gas Transmission as a result of the project are to be accepted by the promoter and are to be recovered on the completion of the work.

On acceptance of National Gas Transmission's requirements, the promoter of the works shall give National Gas Transmission 14 days' notice, or shorter only if agreed with National Gas Transmission, before commencing work on site.

## 2.2 Within the highway

Work shall be notified to National Gas Transmission in accordance with the requirements of The New Roads and Street Works Act (NRSWA) and HS(G)47.

The promoter of any works within the highway should provide National Gas Transmission with details of the proposed works including a method statement of how the work is intended to be carried out. This should be submitted 14 days before the planned work is to be carried out, or shorter only if agreed with National Gas Transmission. If similar works are being carried out at a number of locations in close proximity a single method statement should be adequate.

Work should not go ahead until formal written consent has been given by National Gas Transmission. This will include details of National Gas Transmission's protection requirements, contact telephone numbers and the emergency telephone number.



## 3 HS&E considerations

### 3.1 Safe control of operations

All working practices shall be agreed by National Gas Transmission prior to work commencing. All personnel working on site shall be made aware of the potential hazard of the pipeline and the actions they should follow in case of an emergency. The Site Document Control Form (Appendix A) should be used to record the list of relevant documents that have been provided by National Gas Transmission to persons undertaking work at the site.

### 3.2 Deep excavations

Special consideration should be given to the hazards associated with deep excavations. The HSE document CIS08 'Safety in Excavations' provides further guidance and is available on the HSE website [www.hse.gov.uk](http://www.hse.gov.uk)

### 3.3 Positioning of plant

Mechanical excavators and any other powered mechanical plant shall not be sited or moved above the pipeline unless written authority has been given by the National Gas Transmission responsible person.

Mechanical excavators and any other powered mechanical plant shall not dig on one side of the pipeline with the cab of the excavator positioned on the other side.

Mechanical excavators, any other powered mechanical plant, and other traffic shall be positioned far enough away from the pipeline trench to prevent trench wall collapse.

### 3.4 General

Works in the vicinity of high pressure pipelines may have an impact on the safety of the general public, site workers, National Gas Transmission staff and contractors, and may affect the local environment. Anyone (e.g. contractors, site workers, farmers, local authorities etc.) working close to the pipeline shall carry out suitable and adequate risk assessments prior to the commencement of work to ensure that all such issues are properly considered, and risks mitigated.

## 4 Pipeline locating

Where formal consent to work has been given, the third party should give 14 working days' notice, or shorter, if agreed with National Gas Transmission, to ensure that the pipeline is suitably located and marked out by a National Gas Transmission representative prior to the work commencing.

Before commencing work on site, the pipeline shall be located and pegged or suitably marked out by National Gas Transmission personnel using pipeline location markers with triangular flags (see Appendix B) to indicate the presence of the pipeline. In exceptional circumstances and only with the prior agreement of National Gas Transmission, the locating and marking out of the pipeline could be carried out by competent third parties as long as National Gas Transmission is assured of their competence and the procedures to be followed.

Safe digging practices, in accordance with HSE publication HS(G)47 should be followed as both direct and consequential damage to gas plant can be dangerous both to employees and to the general public.

Previously agreed working practices should be reviewed and revised based on current site conditions. Any changes shall be agreed by the National Gas Transmission responsible person.

The requirements for trial holes to locate the pipeline or determine levels at crossing points shall be determined by the National Gas Transmission responsible person during the initial review of the work.

The excavation of all trial holes shall be supervised by a National Gas Transmission representative.




## 5 Slabbing and other protective measures

No protective measures, including the installation of concrete slab protection, shall be installed over or near to the National Gas Transmission pipeline without the prior permission of National Gas Transmission. National Gas Transmission will need to approve the material, the dimensions and method of installation of the proposed protective measure. The method of installation shall be confirmed through the submission of a formal written method statement from the contractor to National Gas Transmission.

**Note:** A deed of indemnity may be required before a permanent concrete slab is installed over a National Gas Transmission pipeline. See section 2.1.

Where permanent slab protection is to be applied over the pipeline, National Gas Transmission will normally carry out a coating survey of the pipeline to check that there is no existing damage to the coating of the pipeline prior to the slab protection being put in place. This must be carried out prior to the installation of the slab.

The Safety precautions detailed in Sections 3 and 6 of this document should also be observed during the installation of the pipeline protection.

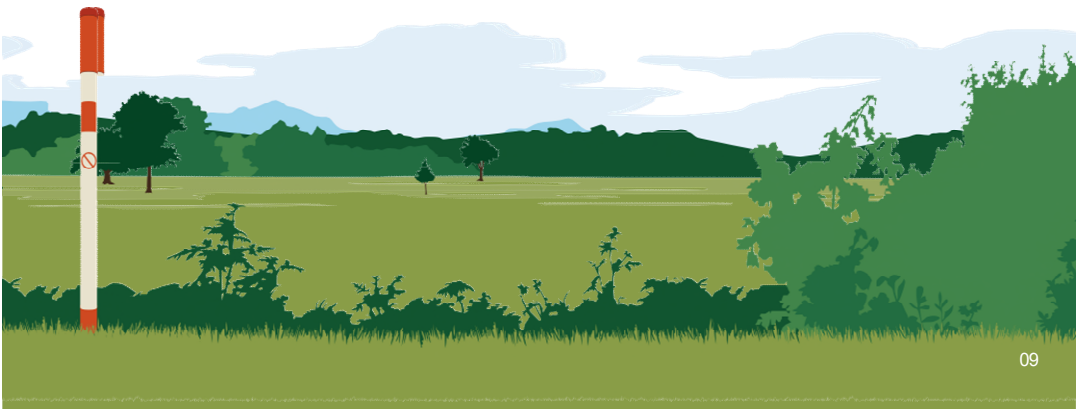

## 6 Excavation

### 6.1 In Proximity to a pipeline in an easement


Third parties may excavate, unsupervised, with powered mechanical plant no closer than 3 metres to the National Gas Transmission pipeline as long as the pipeline has been clearly located and marked out by National Gas Transmission staff. Due to the potential of toothed excavator buckets to damage pipelines, toothless buckets shall be used. Any fitting, attachment or connecting pipework on the pipeline shall be exposed by hand. All other excavation shall be by hand.

Consideration may be given to a relaxation of these limits with the National Gas Transmission responsible person, provided the pipeline position has been confirmed by hand-dug trial holes and only whilst the National Gas Transmission representative remains on site.

Where sufficient depth of cover exists, following evidence from hand dug trial holes, light tracked vehicles may be permitted to strip topsoil to a depth of 0.25 metres, using a toothless bucket.

No topsoil or other materials shall be stored within the easement without the written permission of National Gas Transmission.

Figure 1. Excavation restrictions

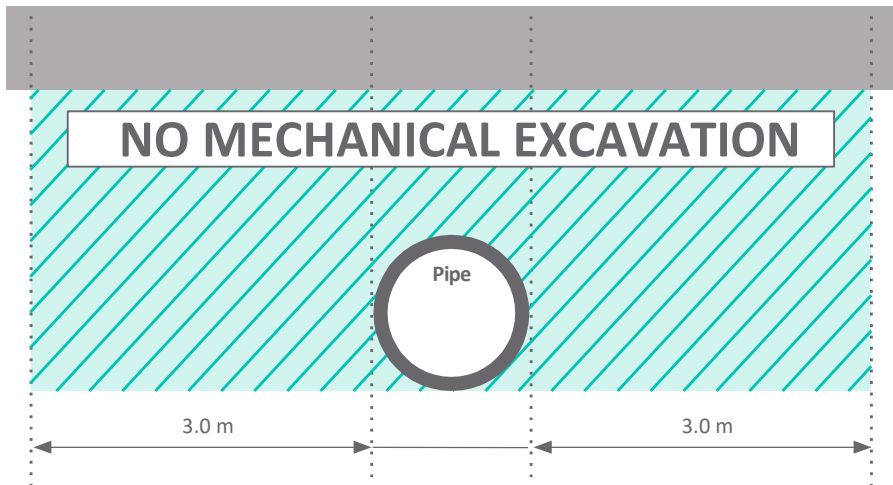

No fires are allowed in the easement strip or close to above ground gas installations.

After the completion of the work the level of cover over the pipeline should be the same as that prior to work commencing, unless agreed otherwise with the National Gas Transmission responsible person.

No new service shall be laid parallel to the pipeline within the easement. In special circumstances, and only with formal written agreement from National Gas Transmission, this may be relaxed for short excursions where the service shall be laid no closer than 0.6 metres to the side of the pipeline.

Where work is being carried out parallel to the pipeline within or just alongside the easement, a post and wire fence shall be erected as a protective barrier between the works and the pipeline.

National Gas Transmission may require that an easement crossing agreement (deed of indemnity) be completed by the third party prior to the commencement of work.

This shall be discussed with the National Gas Transmission responsible person prior to the commencement of the works.

## 6.2 In proximity to a pipeline in the highway

Removal of the bituminous or concrete highway surface layer by mechanical means is permitted to a depth of 0.3 metres, although the use of chain trenchers to do this is not permitted within 3 metres of the pipeline. The National Gas Transmission representative may monitor this work.

Where the bituminous or concrete highway surface layer extends below 0.3 metres deep, it shall only be removed by handheld power assisted tools under the supervision of the National Gas Transmission representative. In exceptional circumstances, and following a risk assessment, these conditions may be relaxed by the National Gas Transmission responsible person.

Third parties may excavate, unsupervised, with powered plant mechanical plant no closer than 3 metres to the located National Gas Transmission pipeline. Any fitting or attachment shall be exposed by hand.

In special circumstances consideration may be given to a relaxation of these rules by agreement with the National Gas Transmission responsible person and only whilst the National Gas Transmission representative remains on site.

The use of 'No-dig' techniques is covered in Section 8.1.

Any new service running parallel to the pipeline should be laid no closer than 0.6 metres to the side of the pipeline (see Section 6.4).

### 6.3 Crossing over a pipeline

Where a new service is to cross over the pipeline, a clearance distance of 0.6 metres between the crown of the pipeline and underside of the service should be maintained. If this cannot be achieved, the service shall cross below the pipeline, see section 6.4.

**In special circumstances consideration may be given to a relaxation of these rules by agreement with the National Gas Transmission responsible person and only whilst the National Gas Transmission representative remains on site.**

### 6.4 Crossing below a pipeline

Where a service is to cross below the pipeline, a clearance distance of 0.6 metres between the crown of the service and underside of the pipeline shall be maintained.

Where lengths of pipeline greater than one metre are to be exposed, the National Gas Transmission responsible person shall be consulted. Any supports shall be removed prior to backfilling.

The exposed pipeline(s) shall be protected by matting and suitable timber cladding.

## 6.5 Cathodic protection

Cathodic Protection is applied to National Gas Transmission's buried steel pipelines and is a method of protecting pipelines from corrosion by maintaining an electrical potential the pipeline and anodes placed at strategic points along the pipeline.

Where a new service is to be laid and similarly protected, National Gas Transmission will undertake interference tests to determine whether the new service is interfering with the cathodic protection of the National Gas Transmission pipeline.

Should any cathodic protection posts or associated apparatus need moving to facilitate third party works, appropriate notice, at least 14 days, shall be given to National Gas Transmission. National Gas Transmission will undertake this work and any associated costs are to be covered by the third party.

## 6.6 Installation of electrical equipment

Where electrical equipment is being installed close to National Gas Transmission's buried steel pipelines, the effects of a rise of earth potential under fault conditions shall be considered by the third party and a risk assessment/earthing report shall be submitted to National Gas Transmission for their approval, prior to the works.

**Note:** A deed of indemnity will be required before any new apparatus (including electric/fibre cables) is installed within the pipeline easement. See section 2.1.


## 7 Construction traffic

Where existing roads cannot be used, construction traffic should ONLY cross the pipeline at previously agreed locations.

All crossing points will be fenced on both sides with a post and wire fence and with the fence returned along the easement for a distance of 6 metres. The pipeline shall be protected, at the crossing points,

by temporary rafts constructed at ground level. The third party shall review ground conditions, vehicle types and crossing frequencies to determine the type and construction of the raft required. The type of raft shall be agreed with National Gas Transmission prior to installation.

Figure 2. Construction traffic requirements

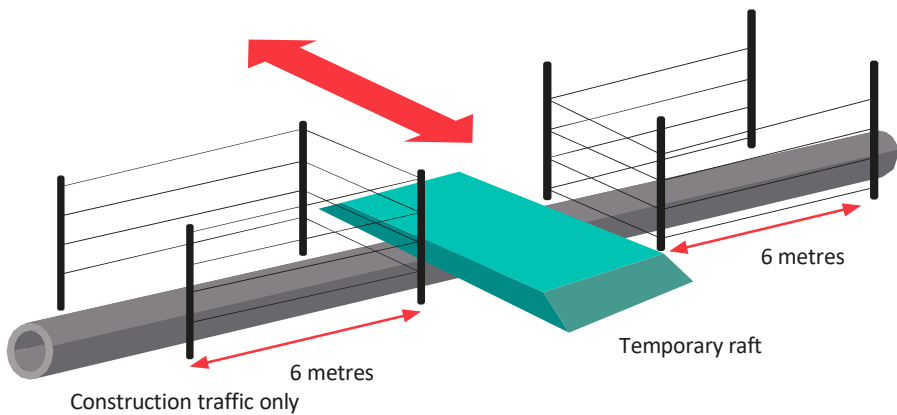



## 8 Specific activities

This section details the precautions that need to be taken when carrying out certain prescribed activities in the vicinity of the pipeline. Consult National Gas Transmission if you are intending to undertake one of the listed prescribed activities and/or require further advice on whether the work that you are intending to undertake has the potential to affect the pipeline.

The table below shows, for some specific activities, the prescribed distances within which the advice of National Gas Transmission shall be sought (see Sections 8.1 to 8.13 for further details):

Activity	Distance within which National Gas Transmission advice shall be sought
Piling	15 m
Surface Mineral Extraction	100 m
Landfilling	100 m
Demolition	150 m
Blasting	250 m
Deep Mining	1000 m
Wind Turbines	Not permitted within 1.5 times the turbine mast height from the nearest edge of a pipeline (please see <a href="http://www.ukopa.co.uk">www.ukopa.co.uk</a> ).

### 8.1 No-dig techniques

Where the third party (e.g. contractor, farmer, local authority, site worker etc.) intends using no dig-techniques

then a formal method statement shall be produced for all work that would encroach (either above or below ground) within the pipeline easement. This method statement shall be formally agreed with National Gas Transmission prior to the commencement of the work. National Gas Transmission may wish to be present when the work is being carried out and shall therefore be given adequate advance notice before the commencement of the work.

## 8.2 Changes to depth of cover

### 8.2.1 Increase in Cover

A pipeline integrity assessment shall be provided for situations involving a final cover depth exceeding 2.5 metres. This assessment should take due account of soil 'dead' loading, ground settlement due to earthworks and the impact of the increased cover on National Gas Transmission's ability to inspect and maintain the pipeline.

Embankment design and construction over pipelines shall give consideration to prevention of any instability. Expert advice may need to be sought which can be arranged through National Gas Transmission.

### 8.2.2 Reduction in Cover

The depth of cover over National Gas Transmission's pipeline shall not be

reduced. National Gas Transmission shall be consulted for any activity proposed that will lead to a reduction in cover over the pipeline. Expert advice may need to be sought which can be arranged through National Gas Transmission.

### 8.3 Piling

No piling shall be allowed within 15 metres of a pipeline without an assessment of the vibration levels at the pipeline. The peak particle velocity at the pipeline shall be limited to a maximum level of 75 mm/sec.

Where the peak particle velocity is predicted to exceed 50 mm/sec, the ground vibration shall be monitored by the contractor and the results made available to the National Gas Transmission responsible person at their request.

Where ground conditions include silt or sand, an assessment of the effect of vibration on settlement and liquefaction at the pipeline shall be made.

Expert advice may need to be sought which can be arranged through National Gas Transmission.

### 8.4 Demolition

No demolition should be allowed within 150 metres of a pipeline without an assessment of the vibration levels at the pipeline. The peak particle velocity at the pipeline shall be limited to a maximum level of 75 mm/sec. Where the peak particle velocity is predicted to exceed 50 mm/sec, the ground vibration shall be monitored by the contractor and the results available to the National Gas Transmission responsible person at their request.

Where ground conditions include silt or sand, an assessment of the effect of vibration on settlement and liquefaction at the pipeline shall be made.

Expert advice may need to be sought which can be arranged through National Gas Transmission.

### 8.5 Blasting

No blasting should be allowed within 250 metres of a pipeline without an assessment of the vibration levels at the pipeline. The peak particle velocity at the pipeline shall be limited to a maximum



level of 75 mm/sec. Where the peak particle velocity is predicted to exceed 50 mm/sec, the ground vibration shall be monitored by the individual/company undertaking the work and the results made available to the National Gas Transmission responsible person at their request.

Where ground conditions include silt or sand, an assessment of the effect of vibration on settlement and liquefaction at the pipeline shall be made.

Expert advice may need to be sought which can be arranged through National Gas Transmission.

## 8.6 Surface mineral extraction

An assessment shall be carried out on the effect of surface mineral extraction activity within 100 metres of a pipeline. Consideration should also be given to extraction around other pipeline associated plant and equipment.

Where the mineral extraction extends up to the pipeline easement, a stable slope angle and stand-off distance between the pipeline and slope crest shall be determined by National Gas Transmission. The easement strip should be clearly marked by a suitable permanent boundary such as a post and wire fence, and where appropriate, slope indicator markers shall be erected to facilitate the verification of the recommended slope angle as the slope is formed, by the

third party. The pipeline easement and slope need to be inspected periodically to identify any signs of developing instability. This may include any change of slope profile including bulging, the development of tension cracks on the slope or easement, or any changes in drainage around the slope. The results of each inspection should be recorded.

Where surface mineral extraction activities are planned within 100 metres of the pipeline but do not extend up to the pipeline easement boundary, an assessment, by National Gas Transmission shall be made on whether the planned activity could promote instability in the vicinity of the pipeline. This may occur where the pipeline is routed across a natural slope, or the excavation is deep. A significant cause of this problem is where the groundwater profile is affected by changes in drainage or the development of lagoons.

Where the extraction technique involves explosives the provisions of section 8.5 apply.

## 8.7 Deep Mining

Pipelines routed within 1 km of active deep mining may be affected by subsidence resulting from mineral extraction. The determination of protective or remedial measures will normally require expert assistance, which can be arranged through National Gas Transmission.

## 8.8 Landfilling

The creation of slopes outside of the pipeline easements may promote instability within the vicinity of the pipeline. An assessment should therefore be carried out, by National Gas Transmission, on the effect of any landfilling activity within 100 metres of a pipeline. The assessment is particularly important if landfilling operations are taking place on a slope in which the pipeline is routed.

## 8.9 Pressure testing

Hydraulic testing of a third-party pipeline should not be permitted within 6 metres either side of a National Gas Transmission pipeline, to provide protection against the effects of a burst.

Where this cannot be achieved, typically where the third-party pipeline needs to cross a National Gas Transmission pipeline, one of the following precautions would need to be adopted:

a) limiting of the design factor of the third-party pipeline to 0.3 at the pipeline's nominated maximum operating pressure (MOP), and the use of pre-tested pipe.

or b) the use of sleeving.

In either case, the third party shall submit of their proposed precautions and method statement for National Gas Transmission consideration.

## 8.10 Seismic surveys

National Gas Transmission shall be advised of any seismic surveying work in the vicinity of pipeline that will result in National Gas Transmission's pipeline being subjected to peak particle velocities in excess of 50 mm/sec. The ground vibration near to the pipeline shall also be monitored by the contractor whilst the survey work is being carried out. Where the peak particle velocity is predicted to exceed 50 mm/sec, the ground vibration should be monitored by the contractor and the results made available to the National Gas Transmission responsible person at their request.

## 8.11 Hot work

The National Gas Transmission responsible person on site should supervise all welding, burning or other 'hot work' that takes place within the easement.

## 8.12 Wind Turbines

Wind turbines shall not be sited any closer than 1.5 times the proposed height of the turbine mast away from the nearest edge of the pipeline. See UKOPA Good Practice Guide UKOPA/GP/013 for more information.

## 8.13 Solar Farms

Solar Farms can be built adjacent to pipelines but never within the easement. Advice shall be sought from National Gas Transmission at the early stages of design to ensure that electrical interference, security, future access, and construction methods can be mutually agreed. See UKOPA Good Practice Guide UKOPA/GP/014 for more information.

## 8.14 Festivals and Large Gatherings

National Gas Transmission shall be informed of any festivals & large gatherings that will result in a temporary population increase in the vicinity of the pipeline. The pipeline easement must be kept clear of any obstructions (which

could include parked vehicles, tents etc.). The event organisers will provide an appropriate risk assessment, including an emergency plan, and detailed site plans for National Gas Transmission's consideration.



## 9 Backfilling

No backfilling should be undertaken without National Gas Transmission agreement to proceed. The National Gas Transmission responsible person will stipulate the necessary consolidation requirements.

Individuals/contractors/companies/organisations undertaking work shall provide National Gas Transmission with 48 hours' notice, or shorter notice only if agreed with National Gas Transmission, of the intent to backfill over, under or alongside the pipeline. This requirement should also apply to any backfilling operations alongside the pipeline within 3 metres of the pipeline.

**Minor damage to pipe coating and test leads will be repaired by National Gas Transmission free of charge.**

Any damage to the pipeline or coating shall be reported to the National Gas Transmission responsible person in order that damage can be assessed, and repairs can be carried out.

If the pipeline has been backfilled without the knowledge of the National Gas Transmission responsible person, they will require the material to be re-excavated to enable the condition of the pipeline coating to be confirmed.

## 10 Action in the case of damage to the pipeline

If the National Gas Transmission pipeline is damaged, even slightly, and even if no gas leak has occurred then the following precautions shall be taken immediately: -

- Shut down all plant and machinery and extinguish any potential sources of ignition.
- Evacuate all personnel from the vicinity of the pipeline.
- Notify the National Gas Transmission responsible person or his office.

immediately using the contact telephone number provided

- Ensure no one approaches the pipeline.
- Do not try to stop any leaking gas.
- Notify National Gas Transmission using the free 24-hour emergency telephone number.

**0800 111 999\***

\*All calls are recorded and may be monitored

## 11 References

<b>NRSWA</b>	New Roads & Street Works Act
<b>HS(G)47</b>	HSE Guidance 'Avoiding Danger from Underground Services'
<b>IGE/SR/18</b>	Safe Working Practices to Ensure the Integrity of Gas Pipelines and Associated Installations (Institution of Gas Engineers)
<b>CIS08</b>	Safety in Excavations (HSE document - see HSE website <a href="http://www.hse.gov.uk">www.hse.gov.uk</a> )
<b>UKOPA</b>	United Kingdom Onshore Pipeline Operators' Association (see UKOPA website <a href="http://www.ukopa.co.uk">www.ukopa.co.uk</a> )
<b>UKOPA/GP/013</b>	Requirements for the Siting and Installation of Wind Turbines Installations in the Vicinity of Buried Pipelines
<b>UKOPA/GP/014</b>	Requirements for the Siting and Installation of Solar Photovoltaic (PV) Installations in the Vicinity of Buried Pipelines
<b>LSBUD</b>	LinesearchbeforeUdig (see LSBUD website <a href="http://www.lsbud.co.uk">www.lsbud.co.uk</a> )

## 12 Glossary of terms

**Deed of Servitude:** In Scotland a 'Deed of Servitude' is considered equivalent to 'easement' in this document.

**Easement:** Easements are negotiated legal entitlements between National Gas Transmission and landowner and allow National Gas Transmission to lay, operate and maintain pipelines within the easement strip. Easement strips may vary in width typically between 6 and 25 metres depending on the diameter and pressure of the pipeline. Consult National Gas Transmission for details of the extent of the easement strip where work is intended.

**Liquefaction:** Liquefaction is a phenomenon in which the strength and stiffness of the soil is reduced by earthquake shaking or other rapid loading.

Liquefaction occurs in saturated soils, that is, soils in which the space between individual particles is completely filled with water. When liquefaction occurs, the strength of the soil decreases and the ability of the soil to support pipelines or other components is reduced.

**Promoter of works:** The person or persons, firm, company, or authority for whom new services, structures, or other works in the vicinity of existing National Gas Transmission pipelines and associated installations operating above 7 bar gauge are being undertaken.

**National Gas Transmission responsible person:** The person or persons appointed by National Gas Transmission with the competencies required to authorise and approve the particular activity.

**National Gas Transmission representative:** The person or persons appointed by National Gas Transmission with the competencies required to carry out on site activities, e.g. monitoring the specific activity, as per the agreed safe working practices.

**Wayleave:** General term which is considered equivalent to 'easement' in this document.

## 13. Privacy Notice

National Gas Transmission collect and process your data in accordance with our Privacy Notice. To view this, please go to <https://www.nationalgas.com/privacy-policy>

## Appendix A

### Site Document Control Form - Sample

<b>EMERGENCY TELEPHONE NO.</b>			
<b>0800 111 999*</b>			
<b>SITE DOCUMENT CONTROL FORM</b>			
<b>Activity reference:</b>			
<b>Activity location:</b>			
<b>Site manager:</b>			
<b>NGT contact:</b>			
<b>The following documents were issued to:</b>			
<b>Individual's name:</b>			
<b>Company name &amp; address:</b>			
<b>By:</b>		<b>Date:</b>	
<b>Documents:</b>			
<b>Signed:</b> <i>(by the recipient)</i>		<b>Date of signature:</b>	
*All calls are recorded and may be monitored			



Site Document Control Form - Sample

<b>EMERGENCY TELEPHONE NO.</b>			
<b>0800 111 999*</b>			
<b>SITE DOCUMENT CONTROL FORM</b>			
<b>Activity reference:</b>			
<b>Activity location:</b>			
<b>Site manager:</b>			
<b>NGT contact:</b>			
<b>The following documents were issued to:</b>			
<b>Individual's name:</b>			
<b>Company name &amp; address:</b>			
<b>By:</b>		<b>Date:</b>	
<b>Documents:</b>			
<b>Signed:</b> <i>(by the recipient)</i>		<b>Date of signature:</b>	

\*All calls are recorded and may be monitored

## Appendix B

### Pipeline Location Flags



## National Gas Transmission contact details:



### EMERGENCY TELEPHONE NO.

**0800 111 999\***

Copyright National Gas Transmission plc 2024©, all rights reserved. No part of this publication may be reproduced in any material form (including photocopying and restoring in any medium or electronic means and whether or not transiently or incidentally) without the written permission of National Gas Transmission plc except in accordance with the provisions of the Copyright, Designs and Patents Act 1988.

© National Gas Transmission plc 2024  
All rights reserved.



# national gas transmission


SELF SERVICE FOR PLANT ENQUIRIES:  
[www.lsbud.co.uk](http://www.lsbud.co.uk)

This is a free online enquiry service giving results within minutes from a grid reference, postcode or street name. This site allows you to submit enquiries about activities and work that you are planning, which may have an impact on the National Gas Transmission Network.

IF YOU ARE PLANNING TO DO WORK NEAR OR IN THE VICINITY OF A PIPELINE AND NEED SUPPORT TO RAISE AN ENQUIRY PLEASE CONTACT

 0800 970 7000\*

 [box.assetprotection@nationalgas.com](mailto:box.assetprotection@nationalgas.com)

 National Gas Transmission House  
Gallows Hill  
Warwick  
CV34 6DA

\*Calls will be recorded and may be monitored

[www.LSBUD.co.uk](http://www.LSBUD.co.uk)



## EMERGENCY

If you hit the pipeline, whether the damage is visible or not, or in the event of an emergency, call the National Gas Transmission Service immediately on

**0800 111 999\***

\*CALLS WILL BE RECORDED  
AND MAY BE MONITORED

T/SP/SSW/22  
March 2024



Printed on recycled paper.